



Quality and reliability is our tradition

KYORITSU

DIGITAL MULTIMETER KEW 1021R

Versatile Digital Multimeter for Electricians

TRUE RMS

- **Elegant and easy-to-use cabinet**
- **Large display with 6000 counts and Backlight**
- **Enhanced current measuring function using an external clamp sensor**
- **Two detachable holders, flat and wing type**
- **Accurate reading with True RMS**
- **Safety Standard IEC61010-1**
CAT IV 300V / CAT III 600V



Ø24
AC
MAX 100A



Ø12
AC
MAX 130A
DC
MAX 180A



Actual Size

KYORITSU ELECTRICAL INSTRUMENTS WORKS,LTD.

<http://www.kew-ltd.co.jp>




KEW 1021R Specifications

DC V	6.000/60.00/600.0V (auto range) ±0.5%rdg±3dgt
DC mV	600.0mV ±1.5%rdg±3dgt
AC V	6.000/60.00/600.0V (auto range) ±1.0%rdg±3dgt [40 - 500Hz]
AC mV	600.0mV ±2.0%rdg±3dgt [40 - 500Hz]
DC A	6.000/10.00A (auto range) ±1.5%rdg±3dgt
AC A	6.000/10.00A (auto range) ±1.5%rdg±3dgt [40 - 500Hz]
Ω	600.0Ω/6.000/60.00/600.0kΩ/6.000/40.00MΩ (auto range) ±0.5%rdg±4dgt(600Ω), ±0.5%rdg±2dgt(6/60/600k/6MΩ), ±1.5%rdg±3dgt(40MΩ)
Continuity buzzer	600Ω (Buzzer sounds below 90Ω)
Diode test	Open-loop voltage:<3.0V
Capacitance	60.00/600.0nF/6.000/60.00/600.0/1000μF ±2.0%rdg±5dgt(60/600nF), ±5.0%rdg±5dgt(6/60/600/1000μF)
Frequency	ACV 99.99/999.9Hz/9.999 / 99.99kHz ±0.1%rdg±3dgt ACA 99.99/999.9Hz/9.999kHz ±0.1%rdg±3dgt
Duty	1.0 - 99.9% ±1.0%rdg ±3dgt [50/60Hz]
Applicable standards	IEC 61010-1 CAT IV 300V / CAT III 600V, IEC 61010-2-033, IEC 61326-2-2
Power source	R03(1.5V)x2
Dimensions	155(L) x 75(W) x 35(D) mm
Weight	250g Approx. (including batteries)
Included Accessories	Wing-type holder, Flat-type holder, 7066A(Test leads) 8919(Ceramic fuse[10A/600V]) x 1(Included), 9097(Carrying case), R03x2, Instruction manual
Optional Accessories	7234(Alligator clips), 8161(AC Clamp sensor) 8115(AC/DC Clamp sensor), 9189(Magnet hanger strap)

Included Accessories



Optional Accessories

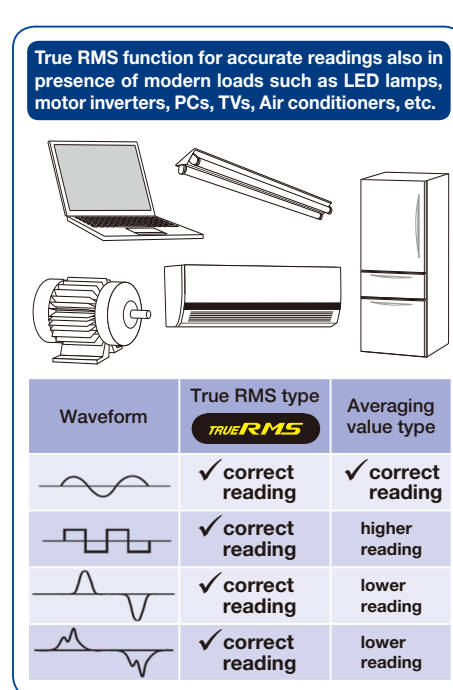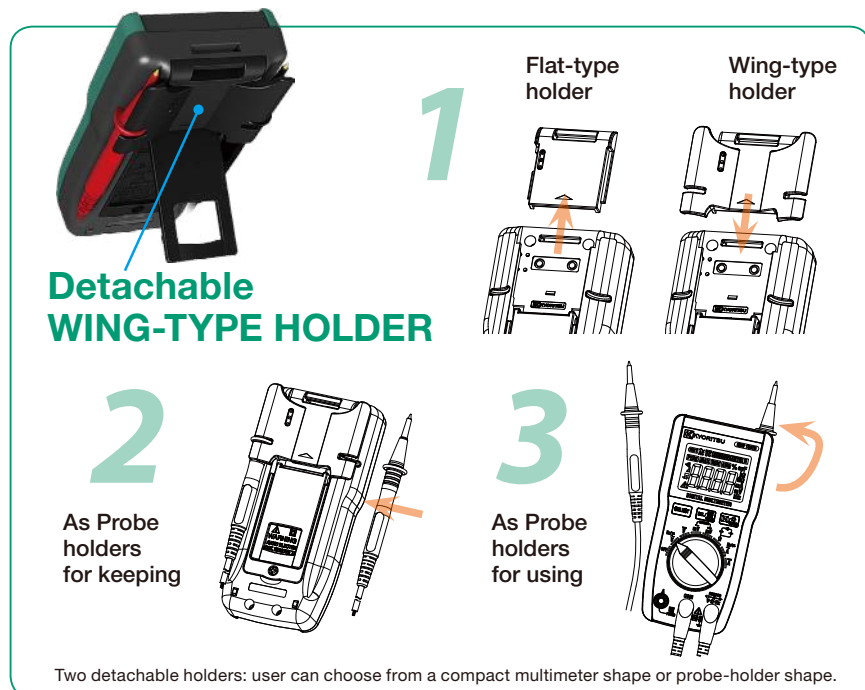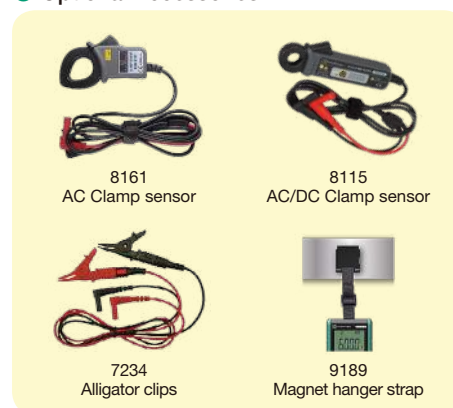

! Safety Warnings : Please read the "Safety Warnings" in the instruction manual supplied with the instrument thoroughly and completely for correct use. Failure to follow the safety rules can cause fire, trouble, electrical shock, etc. Therefore, make sure to operate the instrument on a correct power supply and voltage rating marked on each instrument.

For inquiries or orders :



**KYORITSU ELECTRICAL
INSTRUMENTS
WORKS, LTD.**

2-5-20, Nakane, Meguro-ku, Tokyo, 152-0031 Japan
Phone: +81-3-3723-0131
Fax: +81-3-3723-0152
E-mail: info-eng@kew-ltd.co.jp

<http://www.kew-ltd.co.jp>